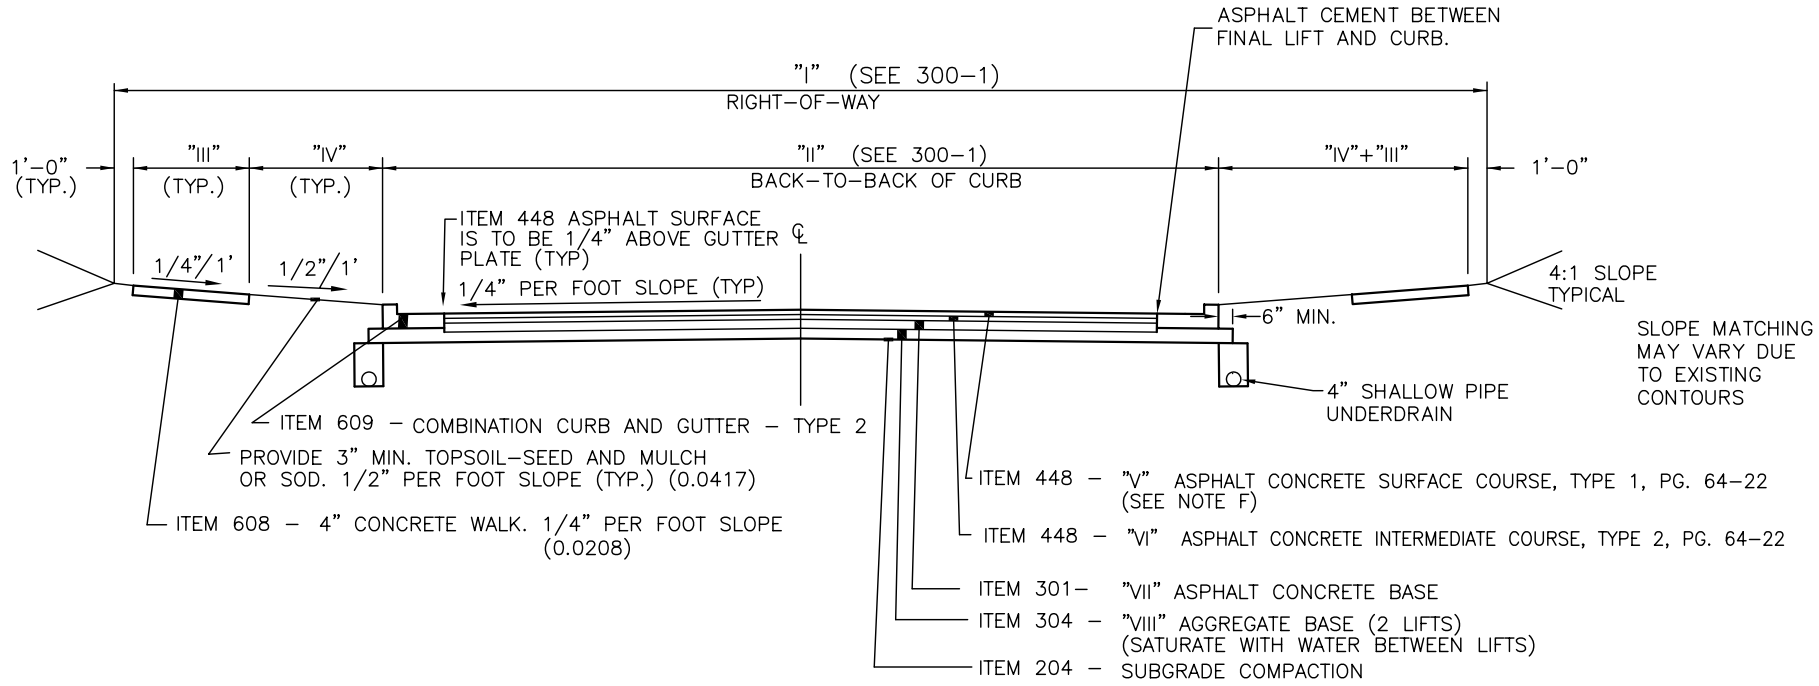

MINIMUM STANDARDS

	ITEM	DESCRIPTION	THOROUGHFARE	COMM.&IND.	COLLECTOR	LOCAL
STANDARD DIMENSIONS	I	RIGHT-OF-WAY	*	60	60	50
	II	B\B CURB	*	41	36	30
	III	SIDEWALK WIDTH	*	5'	4'	4'
	IV	CURB LAWN WIDTH	*	4.5'	7'	4'
AGGREGATE BASE	V	ITEM 448	1-1/4"	1-1/4"	1-1/4"	1-1/4"
	VI	ITEM 448	1-3/4"	1-3/4"	2-3/4"	2-1/4"
	VII	ITEM 301	7"	3"	—	—
	VIII	ITEM 304	6" 2 LIFTS	9" 2 LIFTS	9" 2 LIFTS	9" 2 LIFTS
ASPHALT BASE	V	ITEM 448	1-1/4"	1"	1"	1"
	VI	ITEM 448	1-3/4"	2"	2"	2"
	VII	ITEM 301	8" 2 LIFTS	6" 2 LIFTS	5"	4"

* SEE DESIGN CRITERIA AND CITY ENGINEER

NOTES

A. ALL WORK TO CONFORM TO ODOT CONSTRUCTION AND MATERIAL SPECIFICATIONS LATEST REVISION UNLESS OTHERWISE SPECIFIED.

B. ITEM 407 TACK COAT, SHALL BE REQUIRED WHEN 10 DAYS HAVE ELAPSED BETWEEN BITUMINOUS PAVEMENT LIFTS UNLESS OTHERWISE SPECIFIED BY THE ENGINEER. APPLICATION RATE IS 0.10 GALLON PER SQUARE YARD.

C. ALL BUTT JOINTS SHALL BE SEALED WITH PG 64-22 WITHIN 24 HOURS AFTER PLACEMENT OF ITEM 448.

D. STANDARD DIMENSIONS FOR (II) B\B CURB AND (IV) APRON WIDTH ASSUME PARKING ON BOTH SIDES.

E. SIDEWALK OF 4' WIDTH MAY BE APPROVED BY THE CITY ON ARTERIAL, AND COMMERCIAL. SIDEWALKS ARE NOT REQUIRED ON INDUSTRIAL STREETS.

F. IN AREAS WITH HIGH POTENTIAL OF PUSHING, SHOVING OR HEAVING, USE ITEM 448 ASPHALT CONCRETE SURFACE COURSE TYPE 1 H, PG. 70-22. IN SMALL QUANTITY AREAS USE TYPE 1, PG 64-22 WITH GILSONITE ADDITIVE.

G. NO CONCRETE PAVEMENT WILL BE ACCEPTED.

CITY OF SIDNEY

TYPICAL SECTIONS AND ASPHALT PAVEMENT COMPOSITION

REVISIONS: 06-25-07

DATE APPROVED: FEB. 2002

PAGE No. 300-2