


TYPE 1

COMBINATION ROLL CURB AND GUTTER

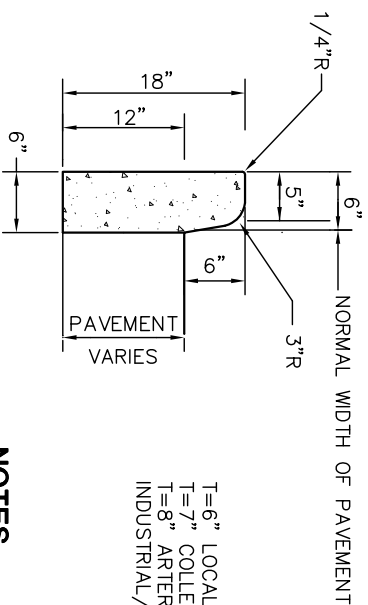

TYPE 6



BARRIER CURB

T=6" LOCAL
T=7" COLLECTOR
T=8" ARTERIAL/
INDUSTRIAL/COMMERCIAL

NOTES

- A.** CONCRETE WORK SHALL MEET THE REQUIREMENTS SET FORTH IN ODOT ITEM 609 CURBING.
- B.** CURBING SHALL HAVE CONTRACTION JOINTS EVERY 10'.
- C.** MINIMUM OF 6" OF ODOT 304 SHALL BE PLACED UNDER CURBING.
- D.** CURBING SHALL BE BACKFILLED IMMEDIATELY AFTER FORMS ARE REMOVED OR AS SOON AS PRACTICAL WHEN SLIP FORMING PRIOR TO OTHER CONSTRUCTION OPERATIONS.
- E.** PROVIDE BROOM FINISH AND EDGING TO ALL EXPOSED SURFACES.
- F.** APPLY CLEAR CURING COMPOUND ON ALL SURFACES INCLUDING BACK IMMEDIATELY AFTER FINISHING SURFACES. ANY OTHER METHOD OR TYPE OF CURING COMPOUND MUST BE PREAPPROVED.
- G.** CONCRETE SHALL BE ODOT CLASS C WITH FIBERMESH (4000 PSI, 600LB/CY CEMENT). PROPORTIONING OPTIONS 1 AND 2 NOT ALLOWED.
- H.** CONCRETE SHALL CONTAIN 6% ± 1% OF TOTAL AIR.
- I.** TYPE 6 CURBS ARE FOR USE AROUND MEDIAN SECTION.
- J.** UNDERDRAIN MUST BE INSTALLED PRIOR TO CURB INSTALLATION.
- K.** MINIMUM FLOW LINE SLOPE OF PERFORATED PIPE IS 0.003 FT/FT TO OUTLET.
- L.** MACHINE CUTTING THE BACK OF CURB MAY BE DONE. APPROVAL FROM CITY ENGINEER PRIOR TO CUTTING IS REQUIRED.

TYPE 2 COMBINATION CURB AND GUTTER

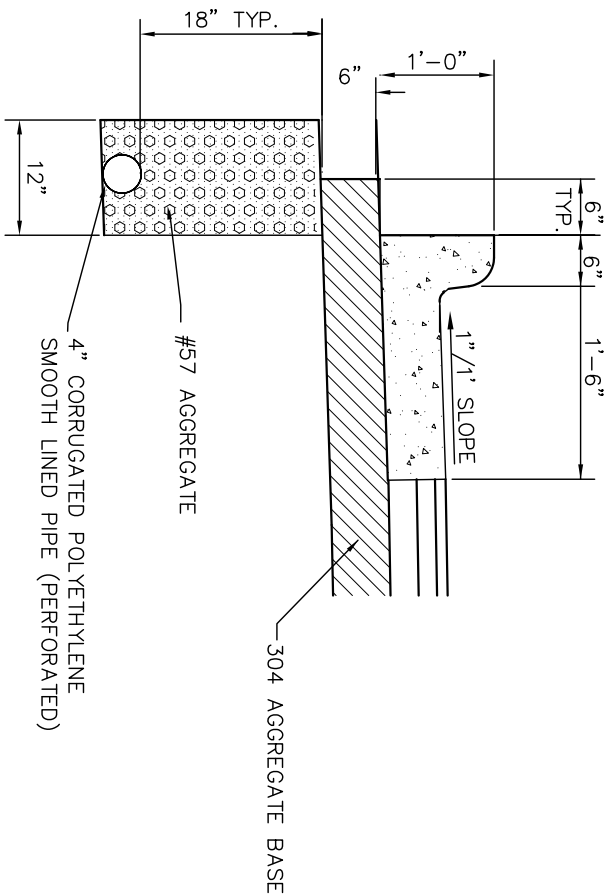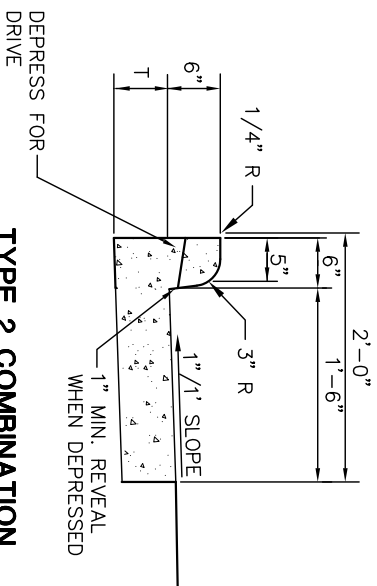

4" SHALLOW PIPE UNDERDRAIN DETAIL
TO BE USED IN NEW DEVELOPMENT WHEN WARRANTED BY GROUND WATER CONDITIONS.