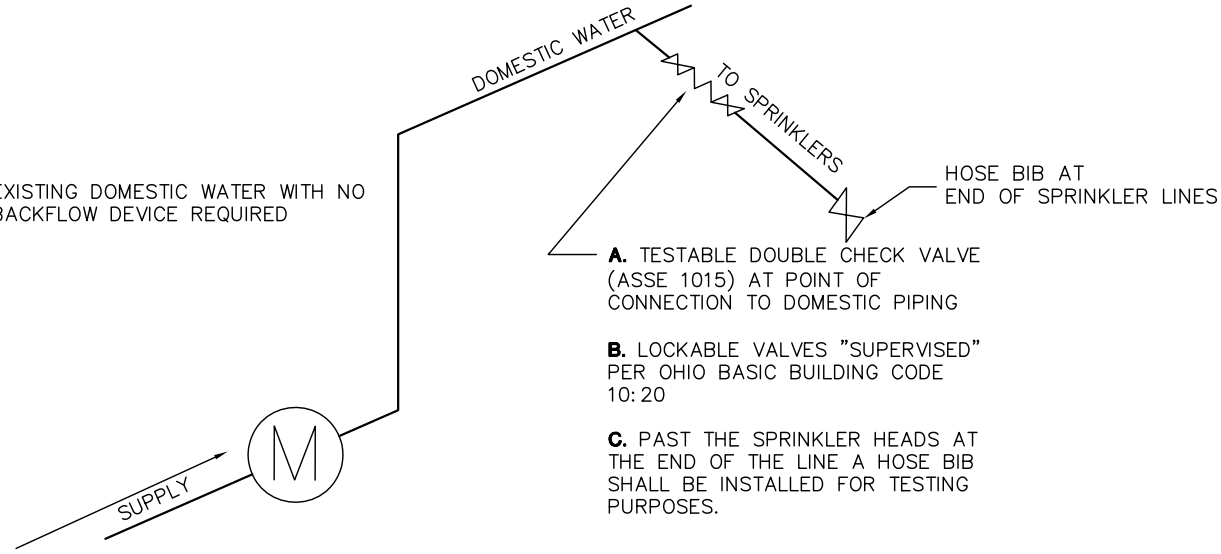

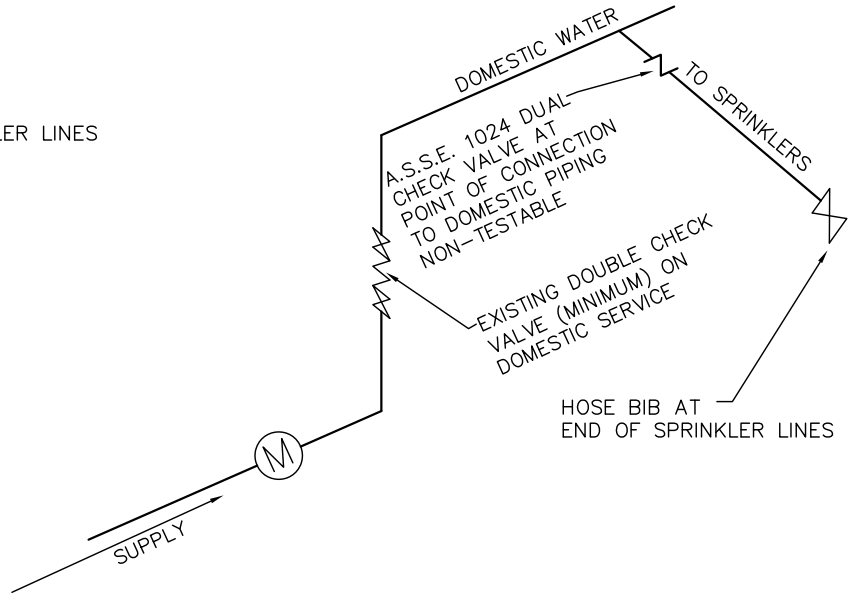

NOTE:

A. ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEM WILL AFFECT ORIGINAL FLOW CALCULATION

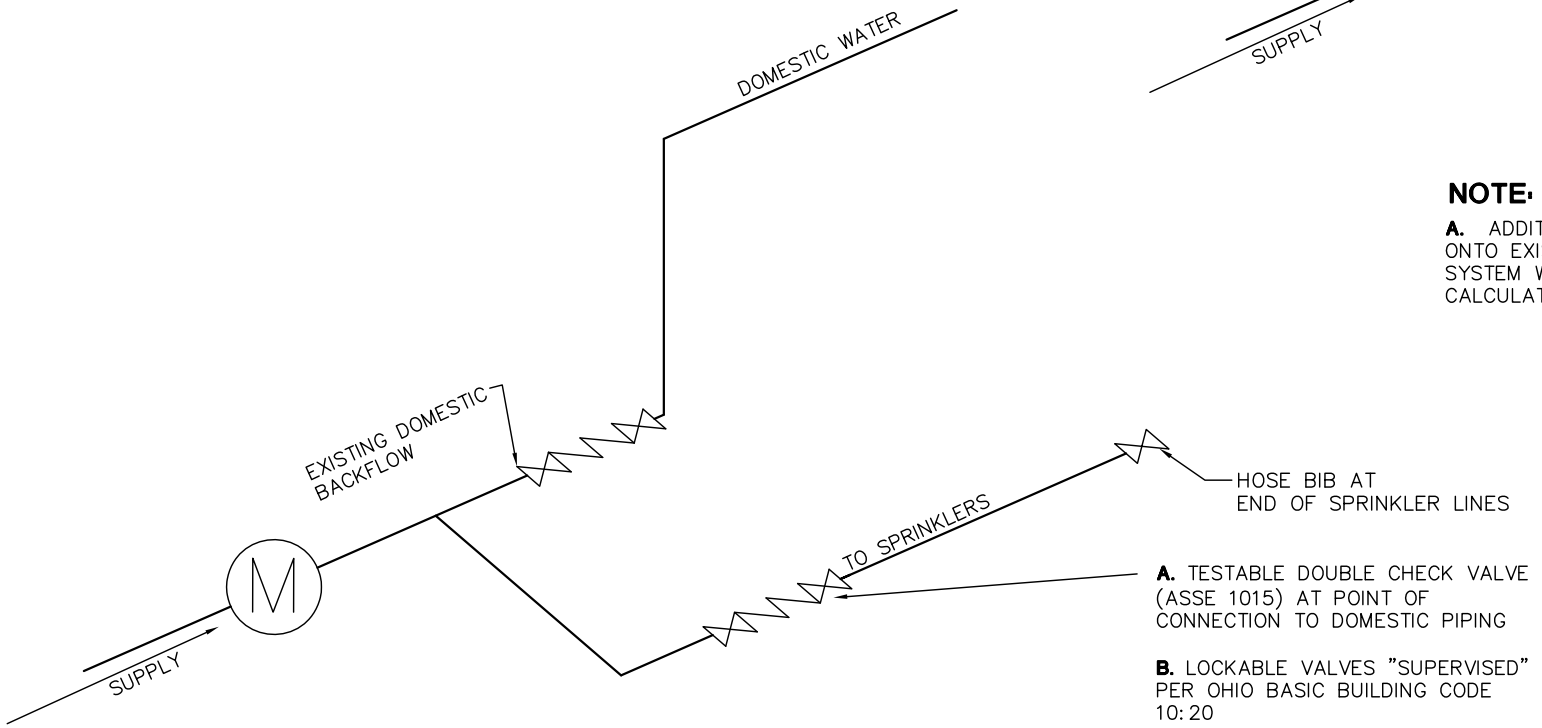

CITY OF SIDNEY	LIMITED AREA SPRINKLER SYSTEM DETAIL	REVISIONS:	DATE APPROVED: FEB. 2002
			PAGE No. 800–13