


NOTES

- A.** ALL UNDERGROUND JOINTS MUST BE RESTRAINED.
- B.** INSIDE PIPING SHALL BE D.I.P. CLASS 53 TO RIGID FLANGE, FROM RIGID FLANGE THROUGH METER VALVES AND BYPASS, TO BE D.I.P. CLASS 53, K-COPPER OR BRASS.
- C.** MINIMUM 1-1/2" WATER METER.
- D.** ALTERNATE DESIGN MAY BE SUBMITTED TO CITY FOR APPROVAL.
- E.** COMBINATION SERVICE NOT PERMITTED INSIDE BUILDING IF THE DOMESTIC METER IS MORE THAN 75 FEET FROM THE PROPERTY/EASEMENT LINE.
- F.** 6" FIRE LINE MAY HAVE A 1" DOMESTIC TAP AND 8" FIRE LINE MAY HAVE A 1-1/2" DOMESTIC TAP. ALL DOMESTIC TAPS MUST BE INSTALLED BEFORE THE SPRINKLER RISER.
- G.** SIAMSESE CONNECTIONS (2-1/2" NATIONAL STANDARD THREADS) TO BE LOCATED ON THE OUTSIDE OF BUILDING.
- H.** UP TO 1" DOMESTIC TAPS CAN BE MADE ON FIRE LINES 6" OR LARGER AS THE TAP IS MADE PRIOR TO THE DETECTION CHECK AND METER.

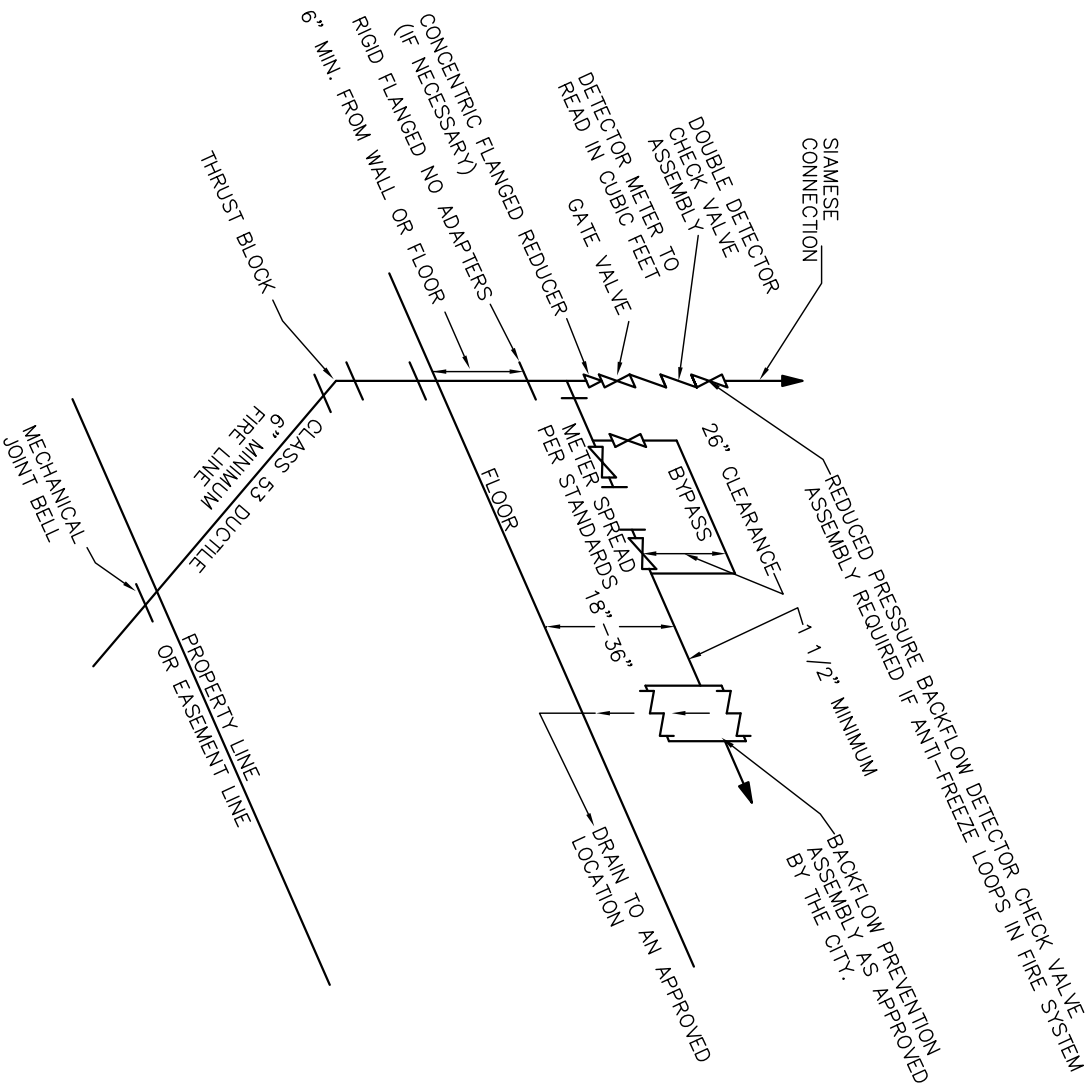

NOTES

- A.** ALL UNDERGROUND JOINTS MUST BE RESTRAINED.
- B.** INSIDE PIPING SHALL BE D.I.P. CLASS 53 TO RIGID FLANGE, FROM RIGID FLANGE THROUGH METER VALVES AND BYPASS, TO BE D.I.P. CLASS 53, K-COPPER OR BRASS.
- C.** MINIMUM 1-1/2" WATER METER.
- D.** ALTERNATE DESIGN MAY BE SUBMITTED TO CITY FOR APPROVAL.
- E.** COMBINATION SERVICE NOT PERMITTED INSIDE BUILDING IF THE DOMESTIC METER IS MORE THAN 75 FEET FROM THE PROPERTY/EASEMENT LINE.
- F.** 6" FIRE LINE MAY HAVE A 1" DOMESTIC TAP AND 8" FIRE LINE MAY HAVE A 1-1/2" DOMESTIC TAP. ALL DOMESTIC TAPS MUST BE INSTALLED BEFORE THE SPRINKLER RISER.
- G.** SIAMSESE CONNECTIONS (2-1/2" NATIONAL STANDARD THREADS) TO BE LOCATED ON THE OUTSIDE OF BUILDING.
- H.** UP TO 1" DOMESTIC TAPS CAN BE MADE ON FIRE LINES 6" OR LARGER AS THE TAP IS MADE PRIOR TO THE DETECTION CHECK AND METER.



**CITY OF
SIDNEY**

**COMBINATION FIRE AND DOMESTIC
IN BUILDING**

REVISIONS:

DATE

APPROVED:
FEB. 2002

PAGE No.

800-14