




# REDUCED PRESSURE DETECTOR ASSEMBLY

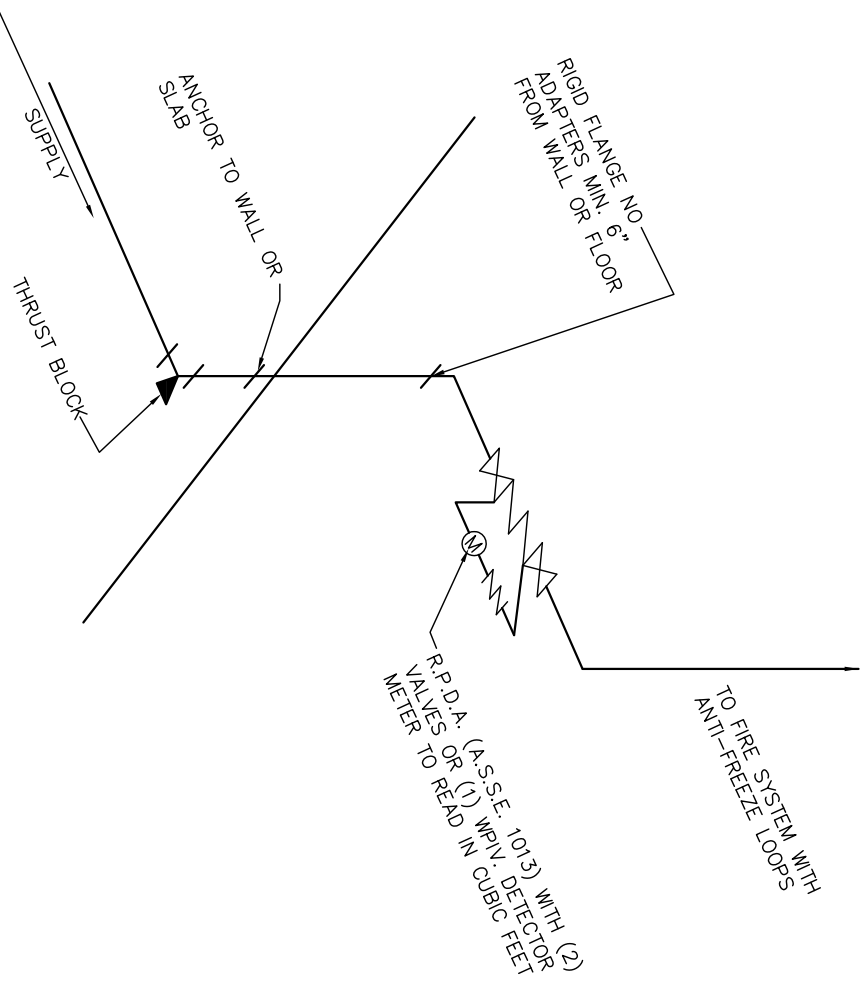

- NOTE:**
- A.** ALL BACKFLOW PREVENTION ASSEMBLIES SHALL BE DELIVERED FOR INSTALLATION COMPLETELY ASSEMBLED BY THE ORIGINAL MANUFACTURER WITH ALL COMPONENTS AS APPROVED.
  - B.** ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEMS WILL AFFECT ORIGINAL FLOW CALCULATIONS.
  - C.** CLASS 53 DUCTILE IRON TO VALVE. ALL JOINTS RESTRAINED.

REVISIONS:

DATE

APPROVED:  
FEB. 2002

PAGE No.  
800-15