




HOSE BIBB

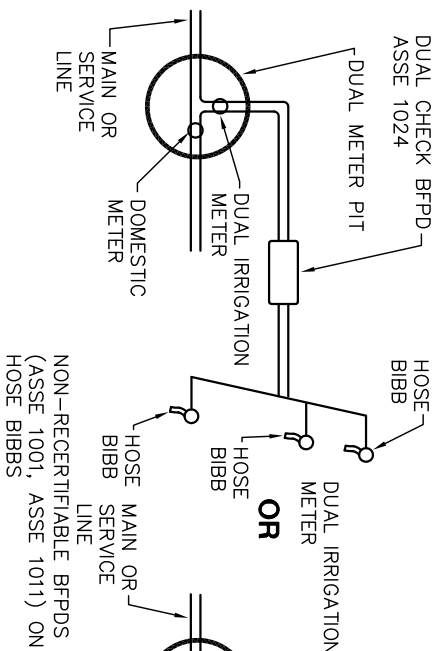

YARD HYDRANT

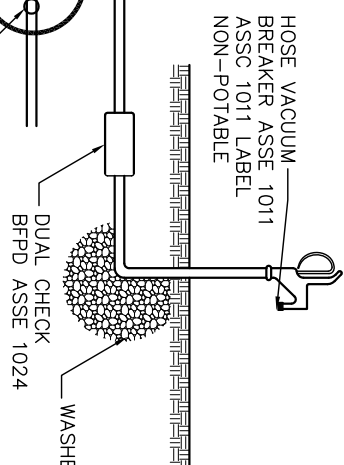


SPRINKLER SYSTEM

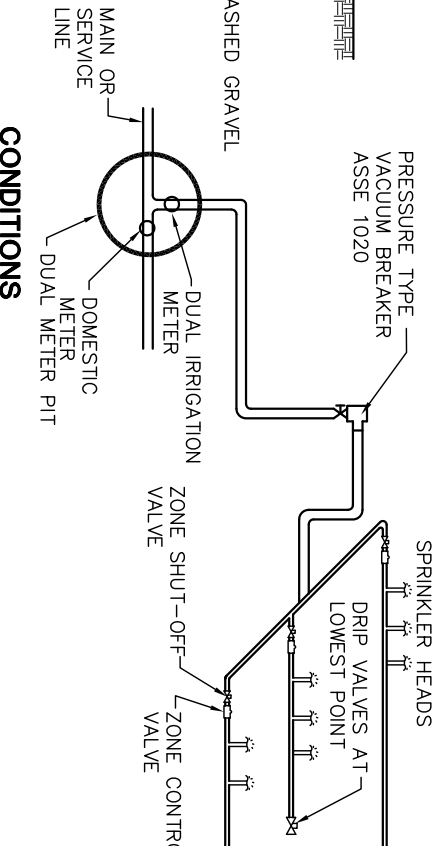

CONDITIONS

- A. SHUT-OFF VALVES ARE ALLOWED DOWNSTREAM OF THE BFPD.
- B. THE PRESSURE TYPE VACUUM BREAKER MUST BE A MINIMUM OF 12" ABOVE THE HIGHEST SPRINKLER HEAD.

YARD MAIN SYSTEM ARRANGEMENT

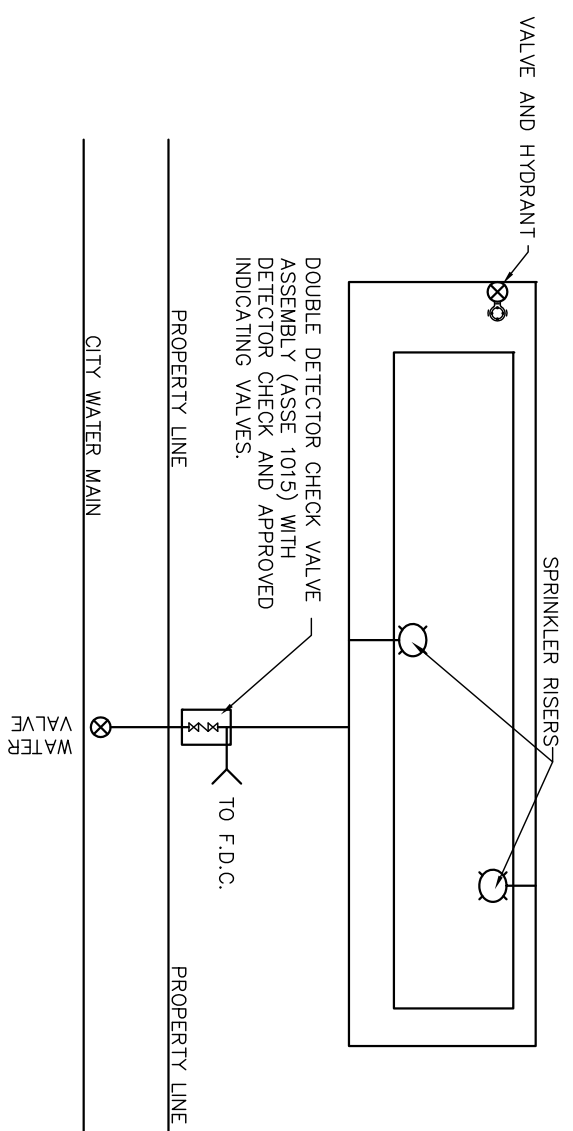

NOTES

- A. A DRAWING OF EACH PROPOSED IRRIGATION SYSTEM MUST BE APPROVED BY THE CITY AND SHELBY COUNTY HEALTH DEPARTMENT PRIOR TO CONSTRUCTION.
- B. IF IRRIGATION SYSTEM IS NONE OF THE ABOVE, USE A REDUCED PRESSURE BACKFLOW PREVENTER, (ASSE 1013), AFTER THE WATER METER.
- C. IRRIGATION CONNECTIONS MUST BE CONNECTED TO MAIN LINE BEFORE DOMESTIC METER AND CONNECTION. NO DEDUCT METER WILL BE ALLOWED.

REVISIONS:	DATE
10-12-09	APPROVED:
07-22-13	FEB. 2002
	PAGE No.