


**2" FIRE LINE SERVICE**  
(METER REQUIRED)

- SERVICE TEES ARE PERMITTED IF**
- A. SHOWN ON AN APPROVED SET OF CONSTRUCTION DRAWINGS.
  - B. 4" MINIMUM BRANCH AND SERVICE LINE WITH GATE VALVE WITHIN 3' OF MAIN.
  - C. 6" FIRE LINE MAY HAVE A ONE-INCH DOMESTIC TAP AND 8" FIRE LINE MAY HAVE A 1-1/2" DOMESTIC TAP. ALL DOMESTIC TAPS MUST BE INSTALLED BEFORE THE FIRE SPRINKLER RISER.

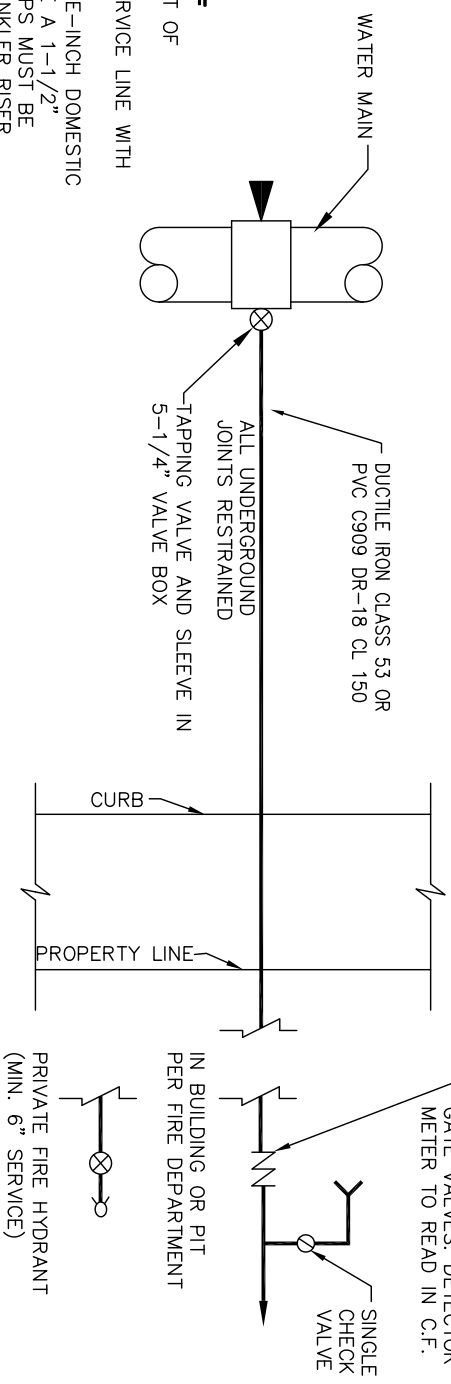

**4" AND LARGER FIRE LINE SERVICE**  
(METER REQUIRED)