




# 1"-3" COMPOUND METER WITH BYPASS

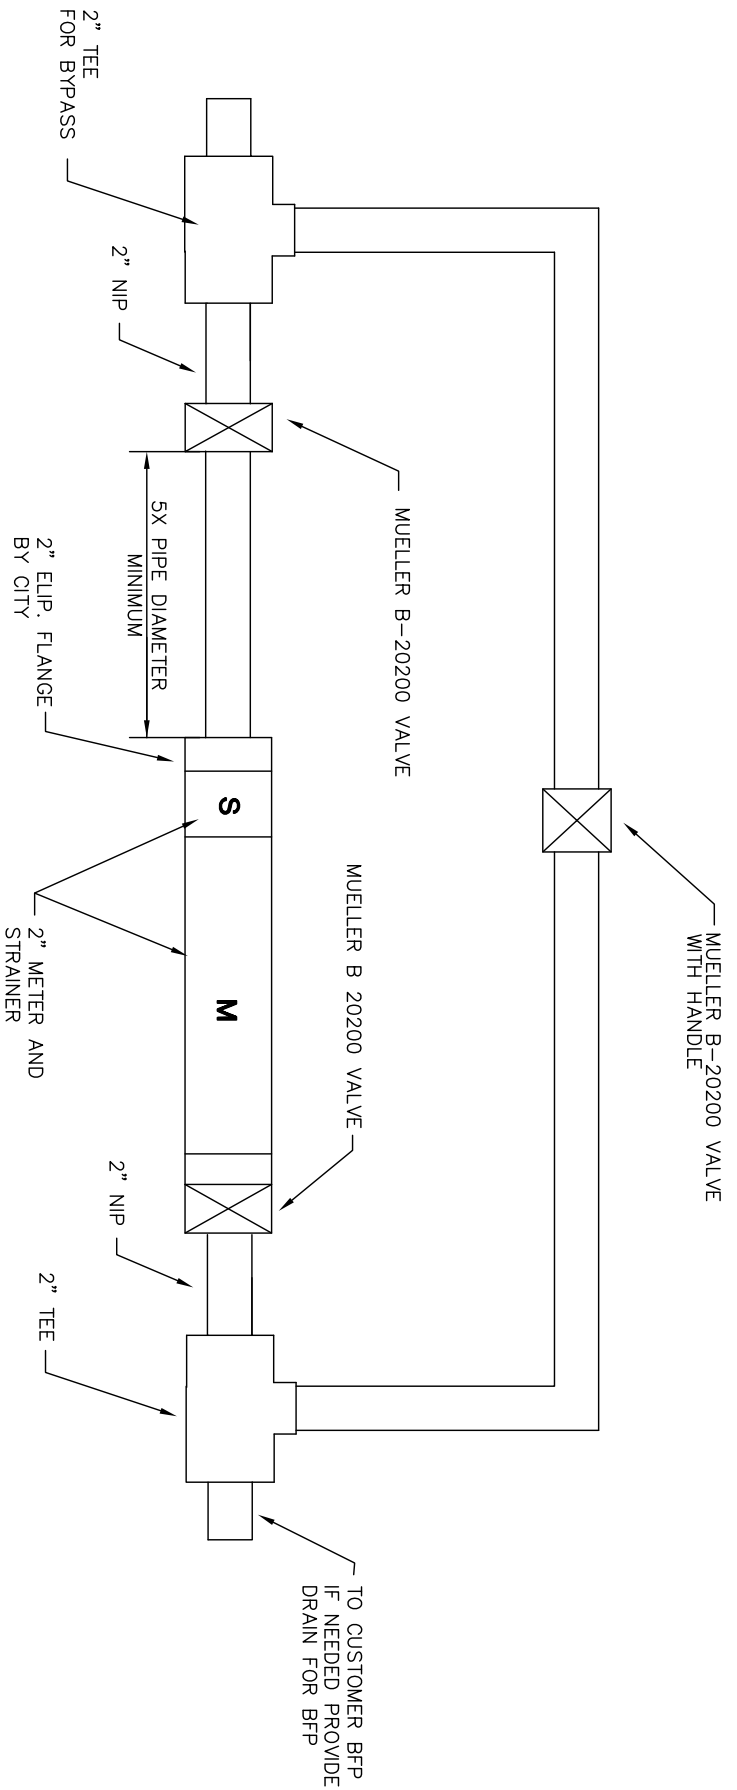

### NOTES

- A.** CENTERLINE OF METER TO BE NO MORE THAN 36" FROM THE FLOOR.
- B.** METER MUST BE MOUNTED HORIZONTALLY INSIDE OF BUILDING.
- C.** USE STAINLESS STEEL OR BRASS NUTS AND BOLTS.
- D.** METER BYPASS ASSEMBLY AND METER SETTING TO BE CONSTRUCTED OF COPPER.
- E.** ALL PIPING TO BE THOROUGHLY SUPPORTED.
- F.** THE CITY IS NOT RESPONSIBLE FOR MAINTENANCE OF INSIDE PLUMBING.
- G.** PROVIDE APPROVED BACKFLOW PREVENTER REGISTERED WITH THE CITY.
- H.** PROVIDE TWO OR THREE (18-22 GAUGE) CONDUCTOR WIRE TO OUTSIDE OF BUILDING NEAR ELECTRIC METER.
- I.** BYPASS VALVE SHALL BE LOCKABLE.
- J.** CURB STOP IS ONLY ITEM INSTALLED OUTSIDE.

REVISIONS:

DATE

APPROVED:  
FEB. 2002

PAGE No.

800-9