


**60" TO 96" PRECAST BASE**  
SEE TABLE FOR MAXIMUM PIPE SIZES

PRECAST OR Poured IN PLACE BASE SECTION WITH 6" GRANULAR BEDDING.  
USE OF BARREL BLOCKS IS CONTINGENT UPON CITY APPROVAL AND THEN  
ONLY IN SPECIAL CASES.

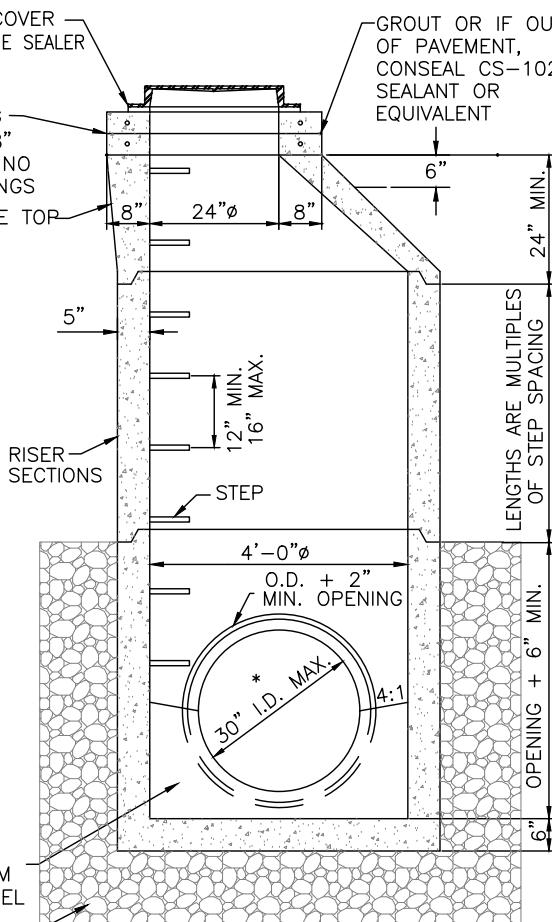

**48" PRECAST BASE**  
FOR 30" & SMALLER PIPE

* BASE I.D.	MIN "t"	MAX. PIPE SIZE
60"	5"	36"
72"	6"	48"
84"	7"	54"
90"	7 1/2	60"
96"	8"	60"

\*DUE TO PIPE ORIENTATION, LARGER  
DIAMETER BASE THAN WHAT IS SPECIFIED  
TO ACCEPT PIPE MAY BE REQUIRED.

## NOTES

- A. STORM MANHOLE FRAME AND APPROVED VENTED LID SHALL BE EQUAL OF NEENAH NO. R-1767 OR EAST JORDAN IRON WORKS NO. 1600. "STORM SEWER" LETTERING TO CASTING.
- B. TOP AND TRANSITION (OR REDUCER) SECTIONS MAY BE EITHER ECCENTRIC CONE OR FLAT SLAB.
- C. OPENINGS IN RISER SECTIONS FOR 18" AND SMALLER INLET PIPES MAY BE PREFABRICATED OR CUT IN THE FIELD PROVIDED THE SIDES OF THE PIPE AT THE SPRING LINE DO NOT PROJECT INTO THE MANHOLE.
- D. MATERIALS FOR BASES AND OTHER PRECAST SECTIONS, INCLUDING REINFORCEMENT SHALL COMPLY WITH ODOT REQUIREMENT OF 706.13 (ASTM C-478).
- E. LOCATE THE CENTERLINE OF MANHOLE CONES OVER THE CENTERLINE OF THE MAIN SEWER WHENEVER POSSIBLE.
- F. FOR PIPE SIZES LARGER THAN 60", REFER TO ODOT TYPE 4 TO 5 MANHOLE.
- G. NO LATERALS MAY PROTRUDE INTO THE INTERNAL MANHOLE.
- H. MAXIMUM SPACING SHALL BE 400'.
- I. WHEN CONNECTING TO AN EXISTING STORM MANHOLE CARE SHALL BE TAKEN TO KEEP OPENING AS MINIMAL AS POSSIBLE. IF POSSIBLE, SAW CUT OR USE ROTARY HAMMER FOR OPENING TO MINIMIZE DAMAGE TO STORM MANHOLE AND PIPE MUST BE CUT PARALLEL TO STORM MANHOLE. USE NONSHRINK GROUT AROUND PIPE TO SEAL BETWEEN PIPE AND STORM MANHOLE.
- J. JOINTS BETWEEN SECTIONS TO BE EITHER MORTAR OR BITUMINOUS PIPE JOINT FILLER (ODOT 706.10)



CITY OF  
SIDNEY

## TYPE 3 STORM MANHOLE

REVISIONS: 10-12-09 07-22-13	DATE APPROVED: 06/03/2020
PAGE No. 600-5	