



EXISTING DOMESTIC WATER WITH NO BACKFLOW DEVICE REQUIRED

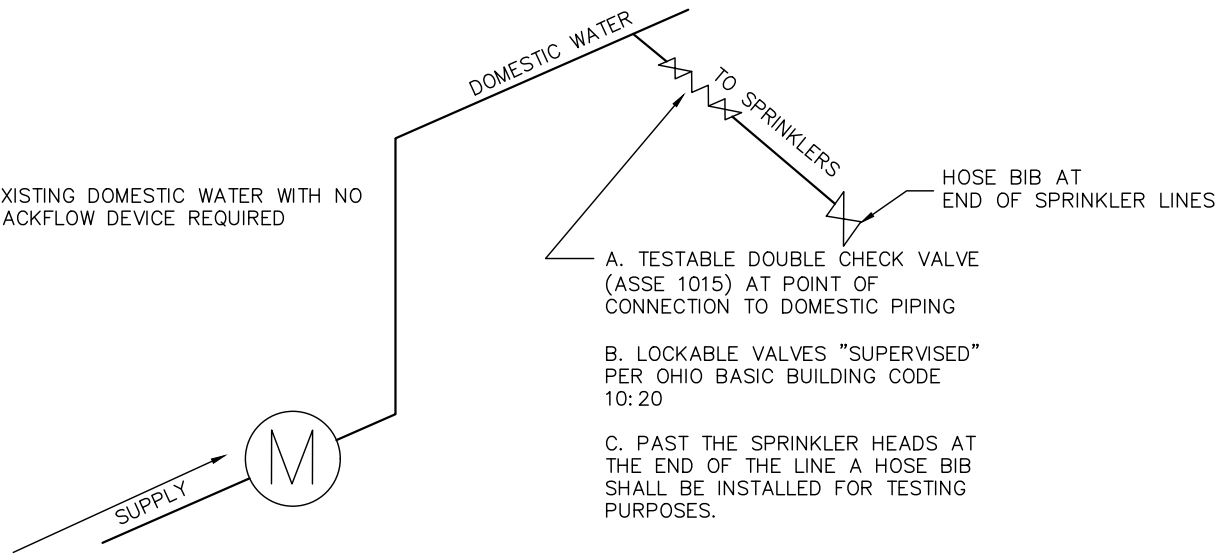

- A. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING
- B. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20
- C. PAST THE SPRINKLER HEADS AT THE END OF THE LINE A HOSE BIB SHALL BE INSTALLED FOR TESTING PURPOSES.


NOTE:

- A. ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEM WILL AFFECT ORIGINAL FLOW CALCULATION
- B. THE FIRE DEPARTMENT SHALL APPROVE AND INSPECT THE FIRE SUPPRESSION SYSTEM.

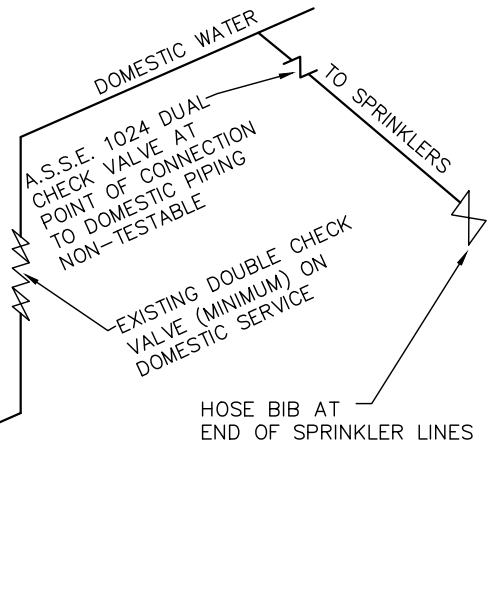

A.S.S.E. 1024 DUAL CHECK VALVE AT POINT OF CONNECTION TO DOMESTIC PIPING NON-TESTABLE

EXISTING DOUBLE CHECK VALVE (MINIMUM) ON DOMESTIC SERVICE

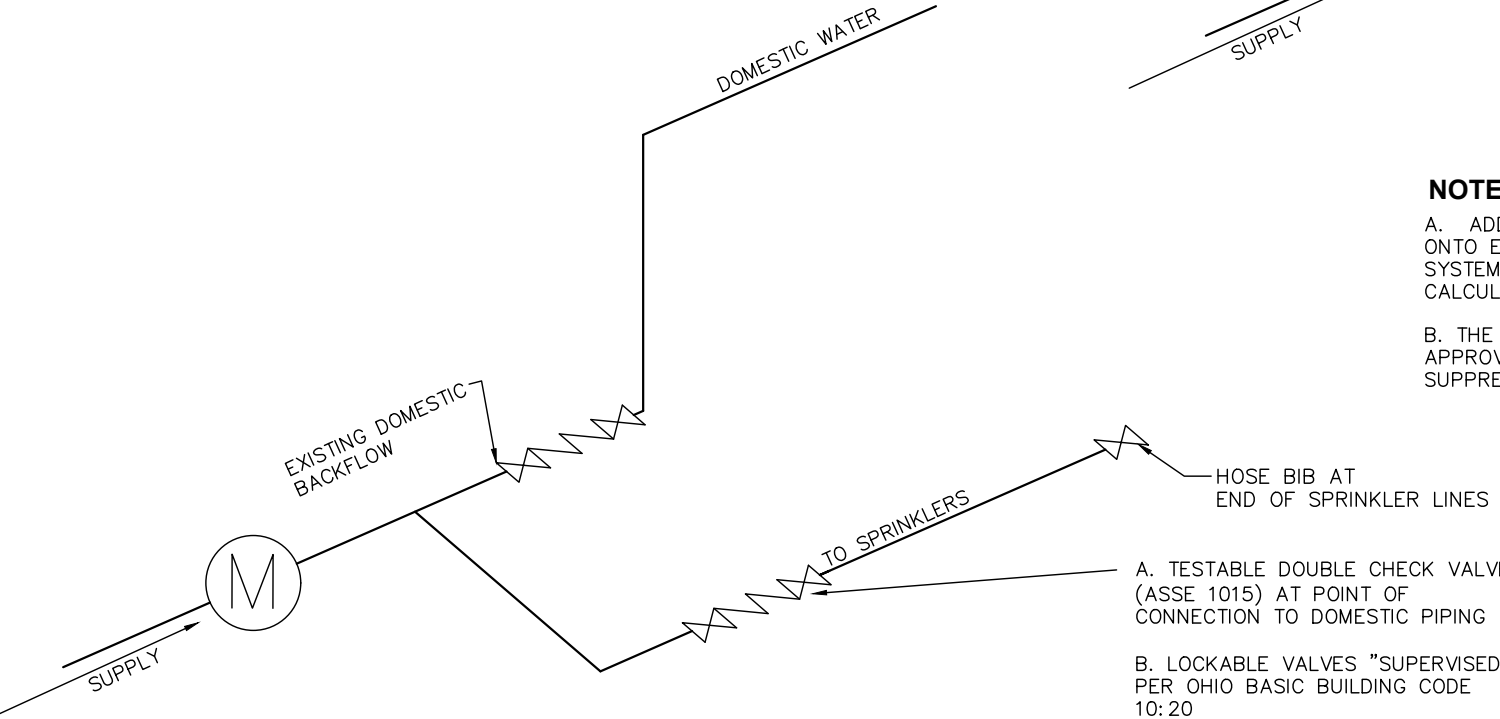

- A. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING
- B. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20



LIMITED AREA SPRINKLER SYSTEM DETAIL

REVISIONS:	DATE APPROVED:
	06/03/2020
	PAGE No.
	800-13